


Figure 5

Variable Scenario: 2012 Utilization Rates with Adjusted Bed Capacities

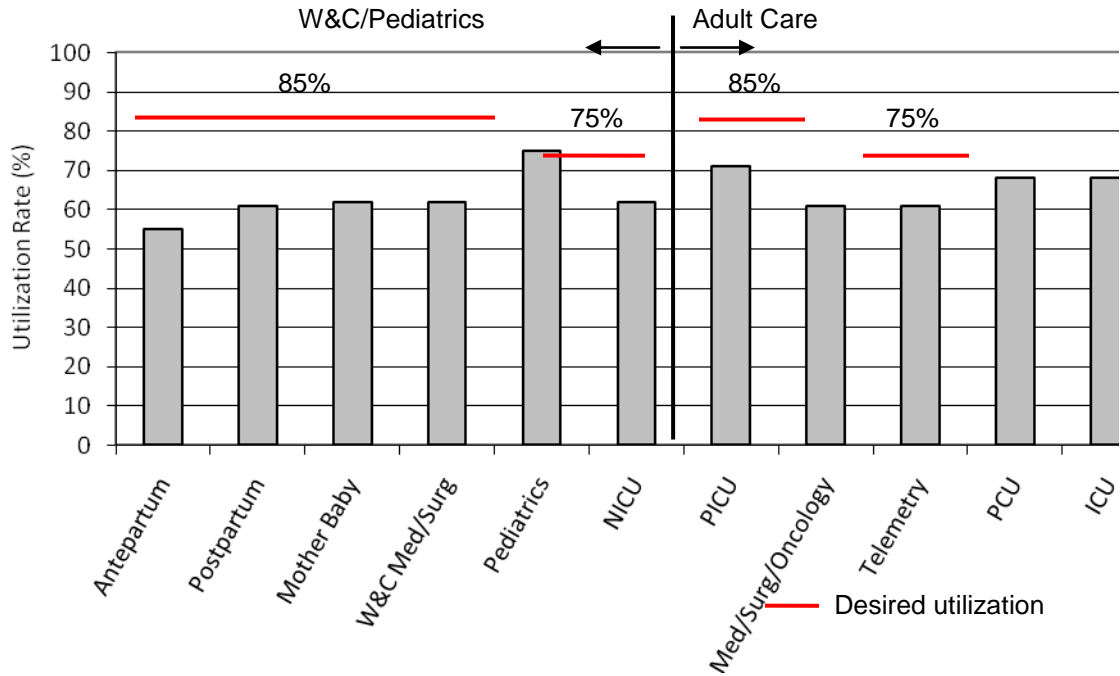

Notes: Number of runs: 30. Run length: 365 days.